



Can I use my existing baseboard radiator piping if upgrading to ductless fan coil units? Maybe. Below, Option 4,5 could be used. Options 1,2,3 cannot be used. Also, if your pipes are steel, iron, or aluminum you should consider upgrading to a stainless steel pump on your Chiltrix air to water heat pump unit.


Option 1: Series Loop System

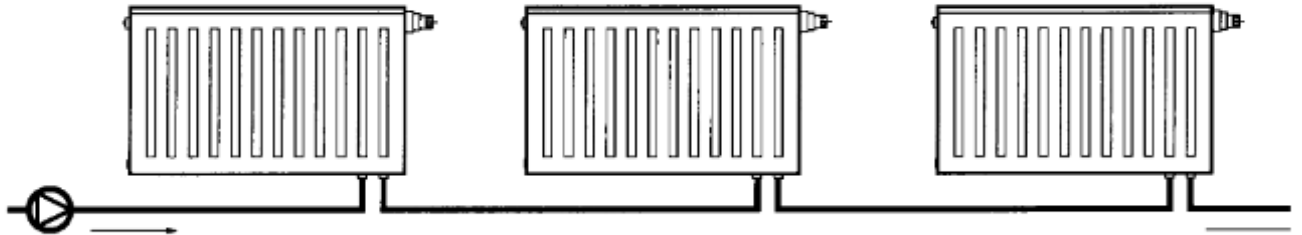


Option 2: One-Pipe System with Venturi Tees or Monoflow Tees.

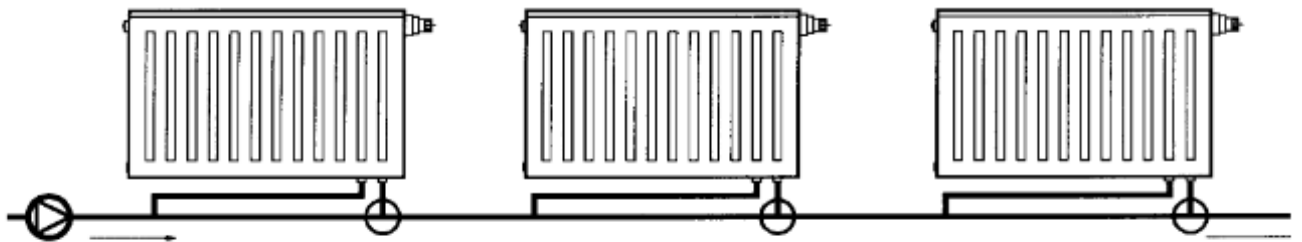

Option 3: One-Pipe System with Diverter Valves

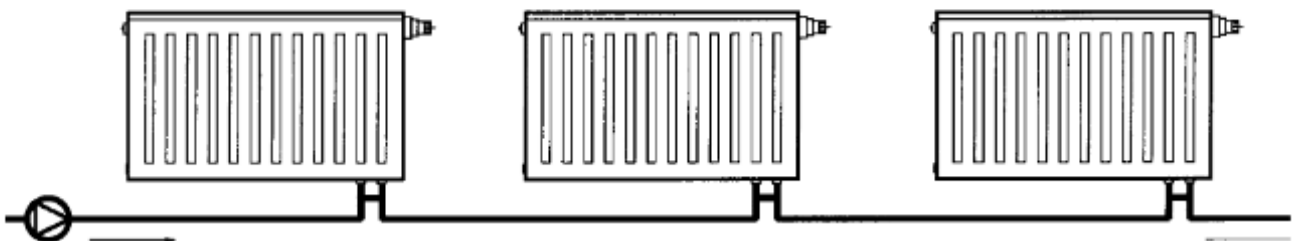

Option 4: Two-Pipe Direct Return System

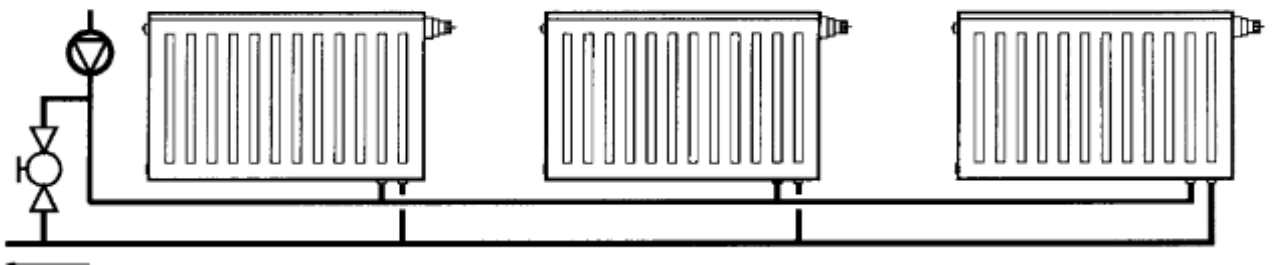

Option 5: Two-Pipe Reverse Return System

